



California Regional Water Quality Control Board

San Diego Region



Matthew Rodriguez
Secretary for Environmental
Protection

Over 50 Years Serving San Diego, Orange, and Riverside Counties

Recipient of the 2004 Environmental Award for Outstanding Achievement from USEPA

Edmund G. Brown, Jr.
Governor

9174 Sky Park Court, Suite 100, San Diego, California 92123-4353

(858) 467-2952 • Fax (858) 571-6972

<http://www.waterboards.ca.gov/sandiego>

February 14, 2012

In reply refer to:
230289:ccannova

Mr. Ken Pintus
Lilac Enterprises Inc.
Hideaway Lake Mobile Home Estates
13076 Falcon Place
Chino, CA 91710

Dear Mr. Pintus:

SUBJECT: REVIEW OF MONITORING REPORTS FOR HIDEAWAY LAKE MOBILE HOME ESTATES


The California Regional Water Quality Control Board, San Diego Region (San Diego Water Board) has reviewed the July-December 2010, January-June 2011, and July-December 2011 semiannual and also the 2010 and 2011 annual monitoring reports submitted for Hideaway Lake Mobile Home Estates in accordance with the Monitoring and Reporting Program of Order No. 93-27.

The following violations of Order No. 93-27 were noted in the reports submitted:

1. The daily maximum discharge specification for biochemical oxygen demand (BOD), established at 45 milligrams per liter (mg/L), was exceeded on September, 14, 2011 with a reported value of 70 mg/L.
2. The daily maximum discharge specification for chloride, established at 150 milligrams per liter (mg/L), was exceeded on December 28, 2011 with a reported value of 165 mg/L.

Please take steps to implement follow-up actions necessary to ensure that the violations noted do not occur in the future. These violations subject the discharger to possible further enforcement action by the San Diego Water Board, including administrative enforcement orders requiring the discharger to cease and desist from violations, or to clean up waste and abate existing or threatened conditions of pollution or nuisance; administrative assessment of civil liability in amounts of up to \$5,000 per day per violation;¹ referral to the State Attorney General for injunctive relief; and referral to the District Attorney for criminal prosecution.


¹ Under authority of California Water Code section 13350.

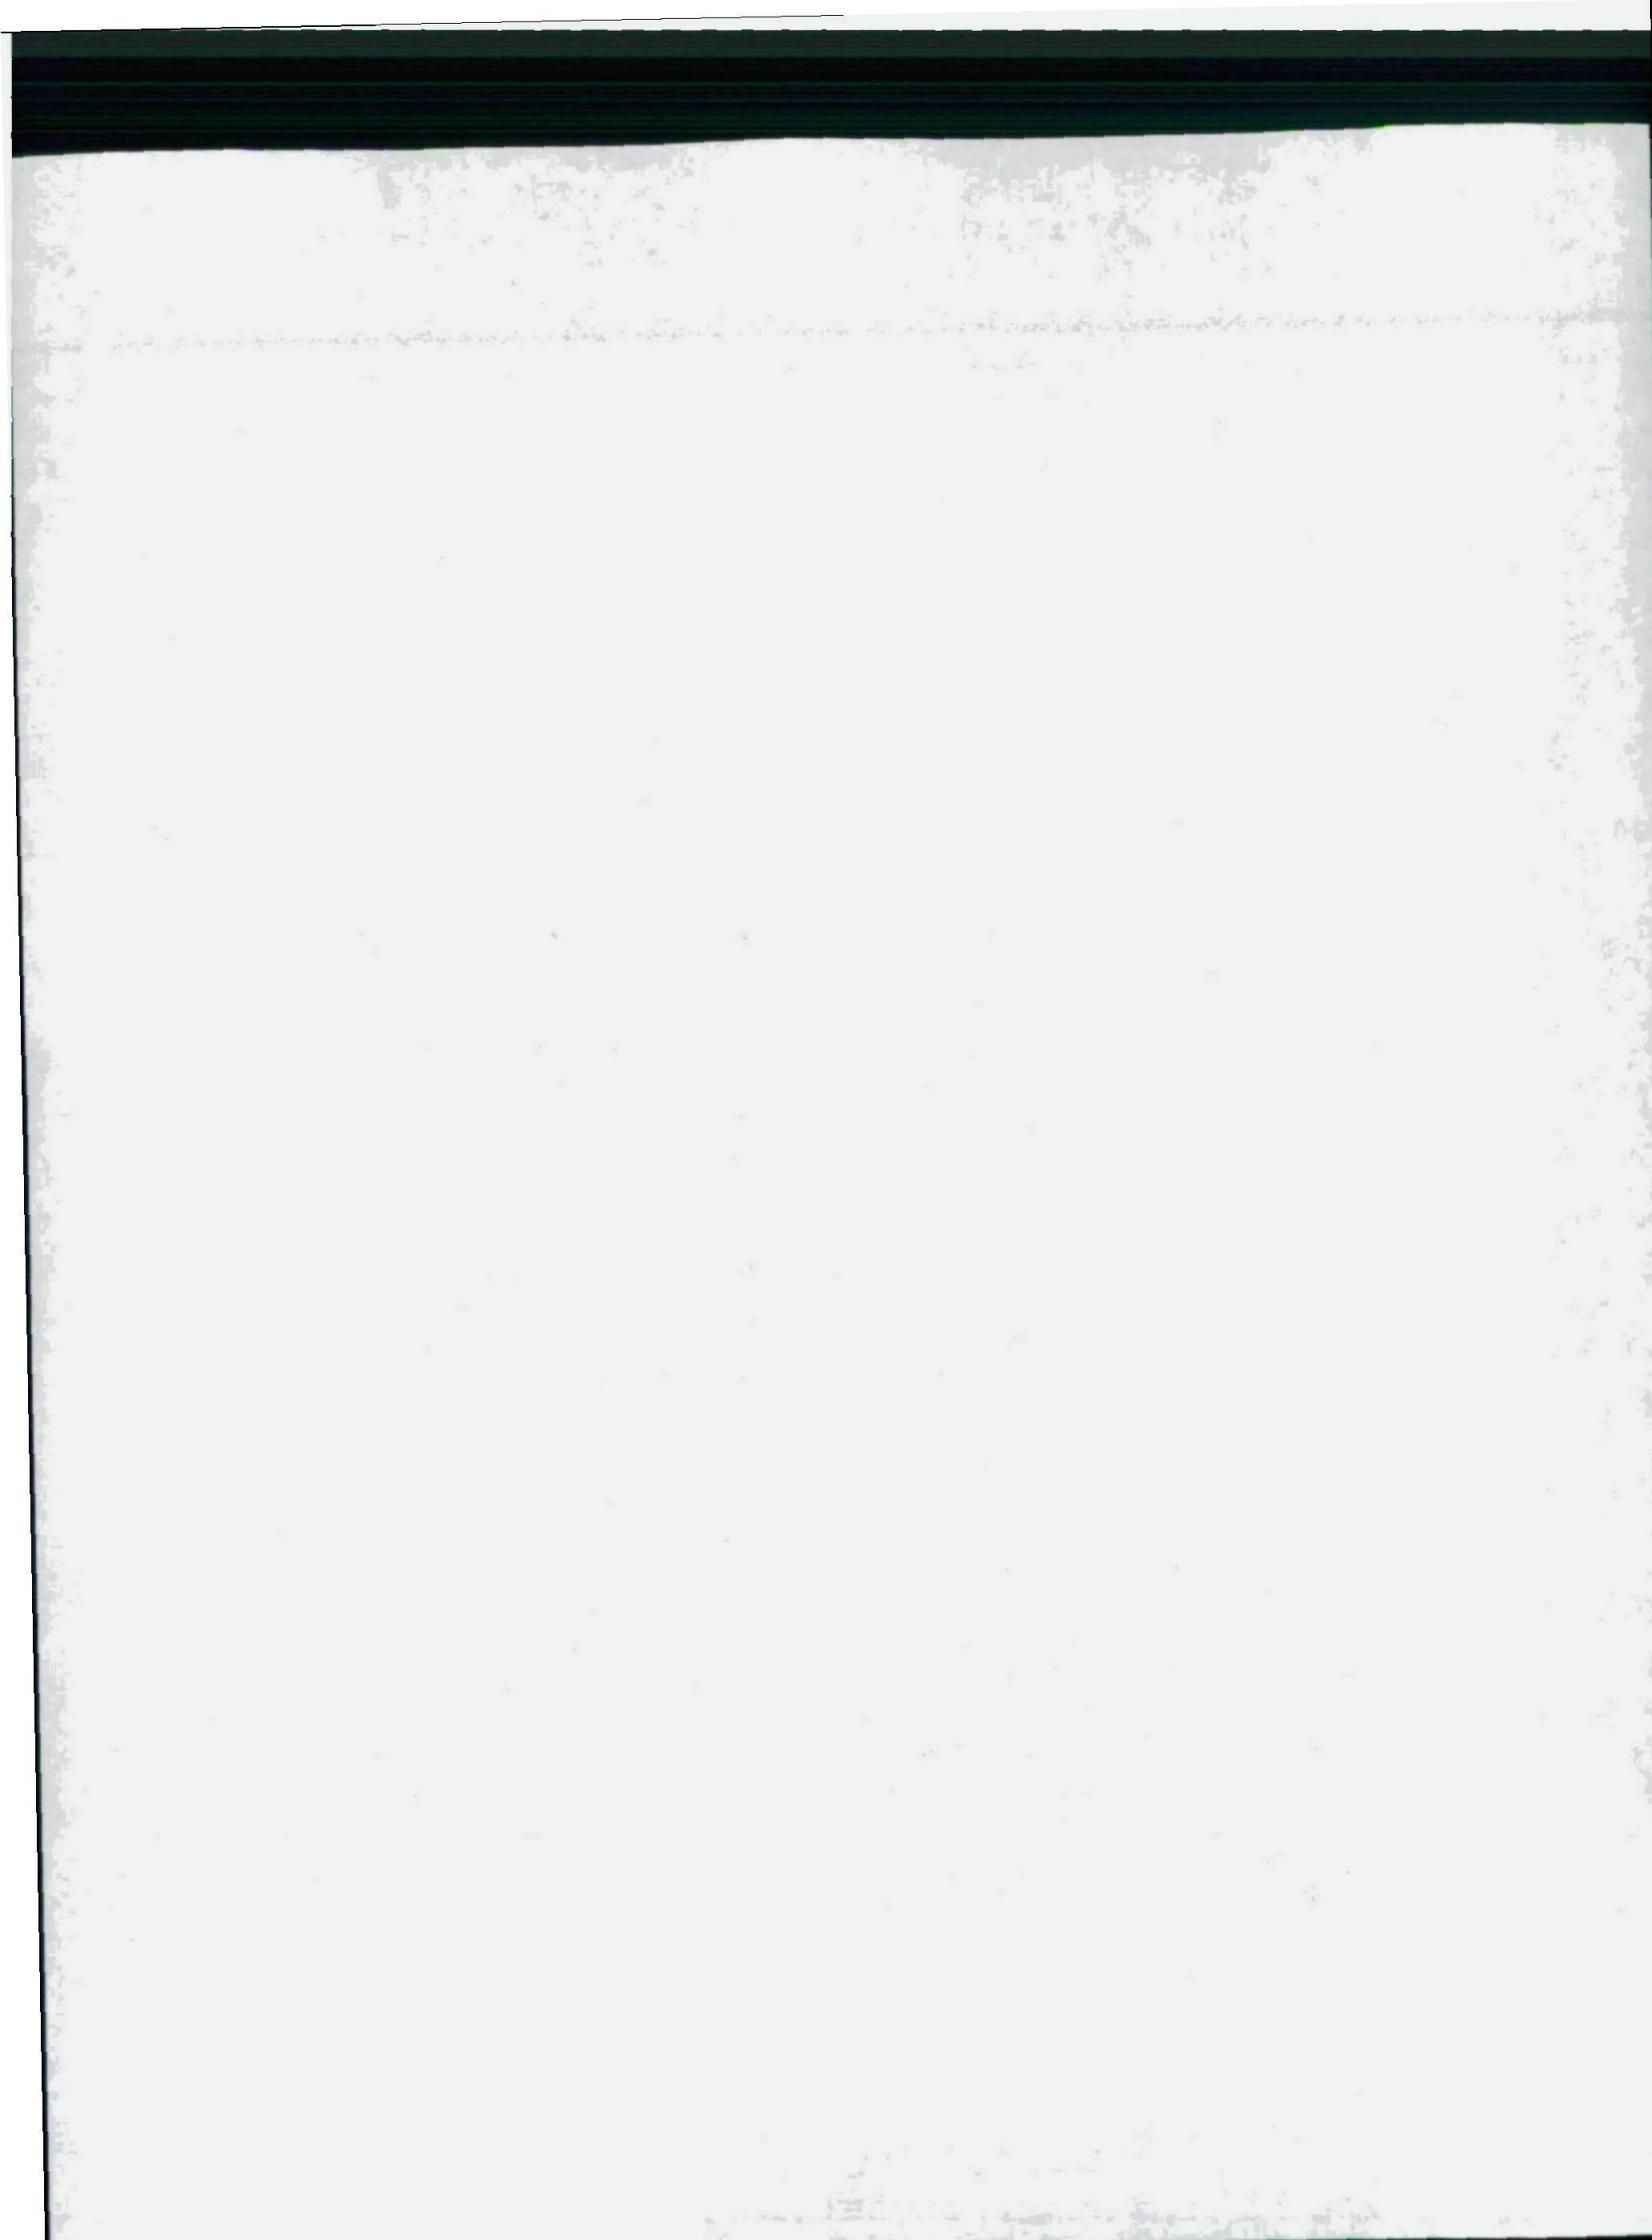

The next monitoring report required to be submitted is the January-June 2012 semiannual monitoring report which is due by July 30, 2012.

In the subject line of any response, please include the requested "In refer to" information located in the heading of this letter. Please contact Ms. Catherine Cannova at (858) 627-3977 or at ccannova@waterboards.ca.gov if you have any questions on this matter.

Sincerely,



Brian D. Kelley,
Senior Water Resource Control Engineer
Cleanup and Land Discharge Branch

Regulatory Measure ID: 383067
Violation ID: 1) 918738 2)871660

